

2


1

NOTES:

1. CABINET IS RATED TYPE 3R AND CONSTRUCTED FROM CODE GA GALV STEEL
2. DUAL COVER METERS HAVE HOLD DOWN SCREW TO KEEP TOP COVER FASTENED
3. **ONLY FACTORY PREFABRICATED KNOCKOUTS ON THE ENCLOSURE SHALL BE USED.**
4. THESE DEVICES TO BE USED UP TO 600 VOLT SERVICES AND UP TO 4 WIRE SERVICES ONLY
5. TEST SWITCH AND EXITING WIRE HARNESS PROVIDED AND INSTALLED BY CONTRACTOR.
6. TEST SWITCHES MOUNTED WITH ARC RESISTANT BARRIER INSIDE FRONT COVER
7. BARREL LOCK GUARD PROVISION ON FRONT LOWER COVER ALONG WITH STAINLESS STEEL PADLOCKABLE HASP FOR UTILITY LOCKING PROVISIONS

B

B

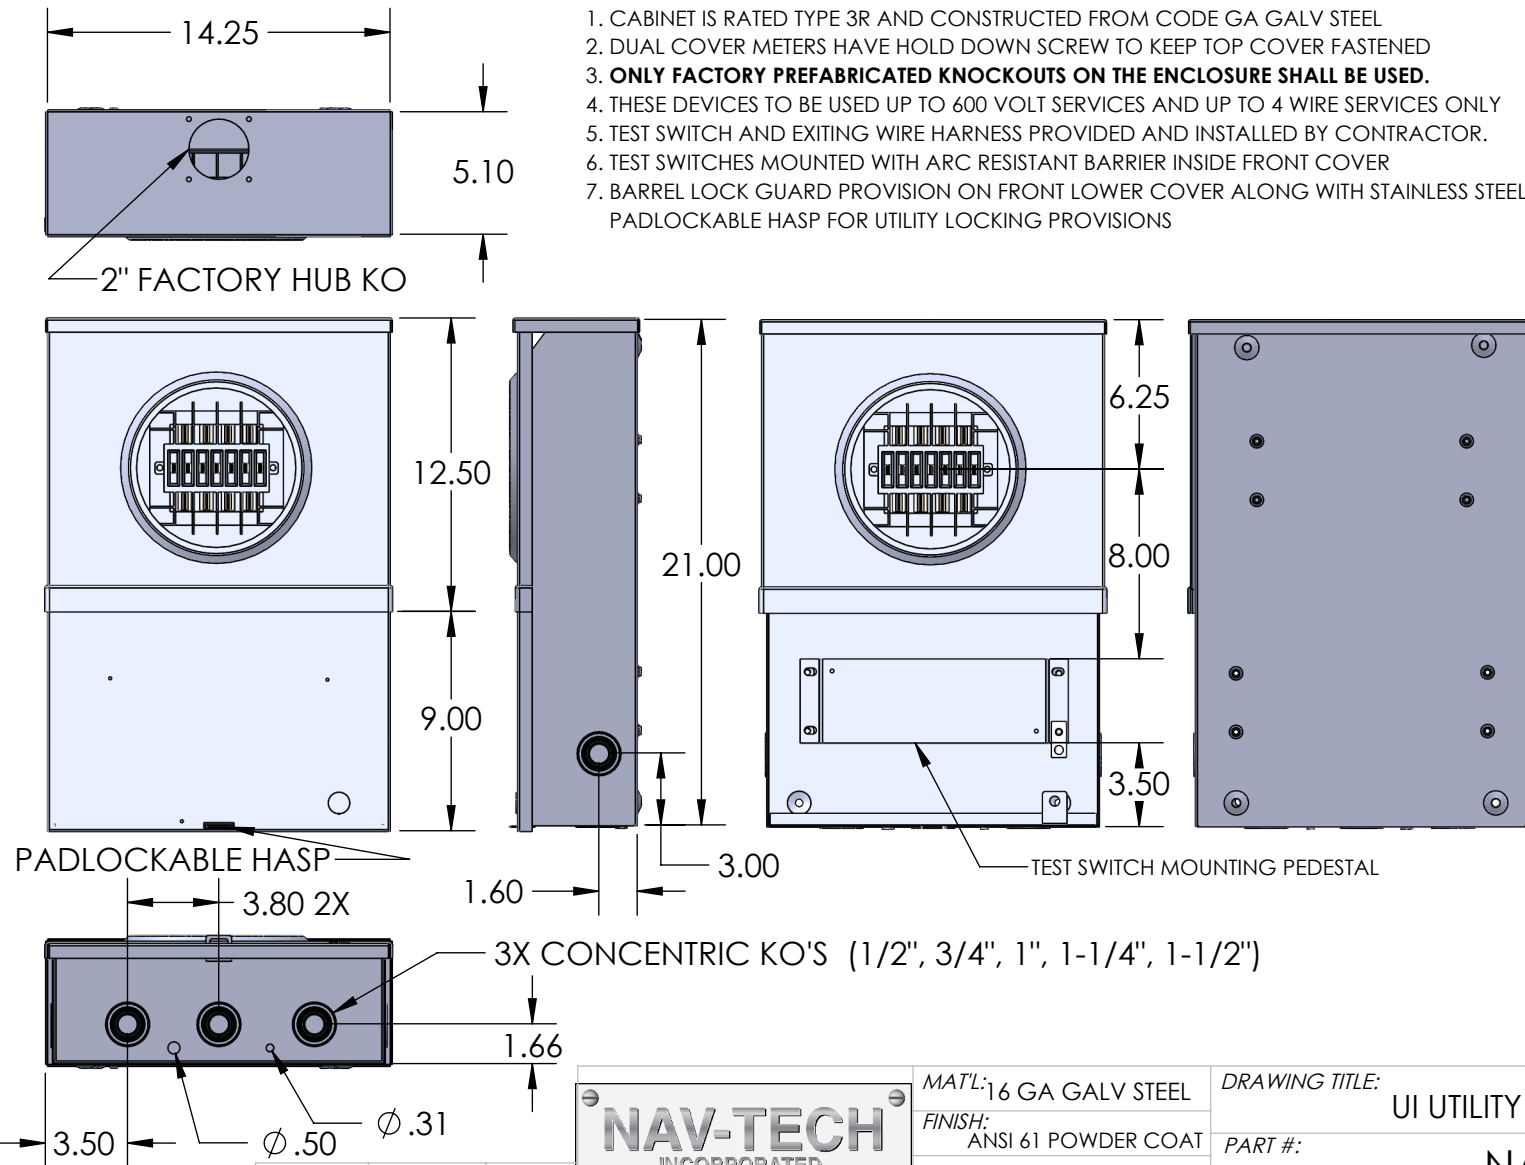

A

A

NAME	DATE
DRAWN BY J. Pincus	11/26/2024
APPROVED BY	

PROPRIETARY AND CONFIDENTIAL
THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF Nav-Tech Inc. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF Nav-Tech Inc. IS PROHIBITED.

NAV-TECH
INCORPORATED

155 MARCUS BLVD
HAUPPAUGE, NEW YORK 11788
PH: (718) 257-2111 FAX: (718) 257-2626

UNLESS OTHERWISE SPECIFIED:
TOLERANCE:
FRACTIONAL $\pm 1/64$ ANGULAR: MACH $\pm 30^\circ$
BEND $\pm 1^\circ$
0.00" = ± 0.01 "
0.000" = ± 0.005 "
DIMENSIONS IN INCHES [SECONDARY IN MM]

MATL: 16 GA GALV STEEL
FINISH: ANSI 61 POWDER COAT
WEIGHT:

- UNLESS OTHERWISE SPECIFIED
1. REMOVE ALL BURRS AND BREAK ALL SHARP EDGES .015 X 45° OR .015R
 2. DIMENSIONAL LIMITS APPLY AFTER PLATING
 3. $\frac{125}{\sqrt{\quad}}$ MACHINED SURFACES EXCEPT AS NOTED

DRAWING TITLE: UI UTILITY 3 PHASE CT RATED METER

PART #: NAV-UI-MS10P-3

DESCRIPTION: UI UTILITY 3 PHASE 4 WIRE
DUAL COMPARTMENT CT RATED METER PAN
RATED 30A, 600V MAX

**DO NOT SCALE
DRAWING**

SCALE: 1:8

SIZE

A

SHEET

1 OF 1

REV.

0

2

1